




# LOSS WITH WATER DIAGRAM

Art: 104

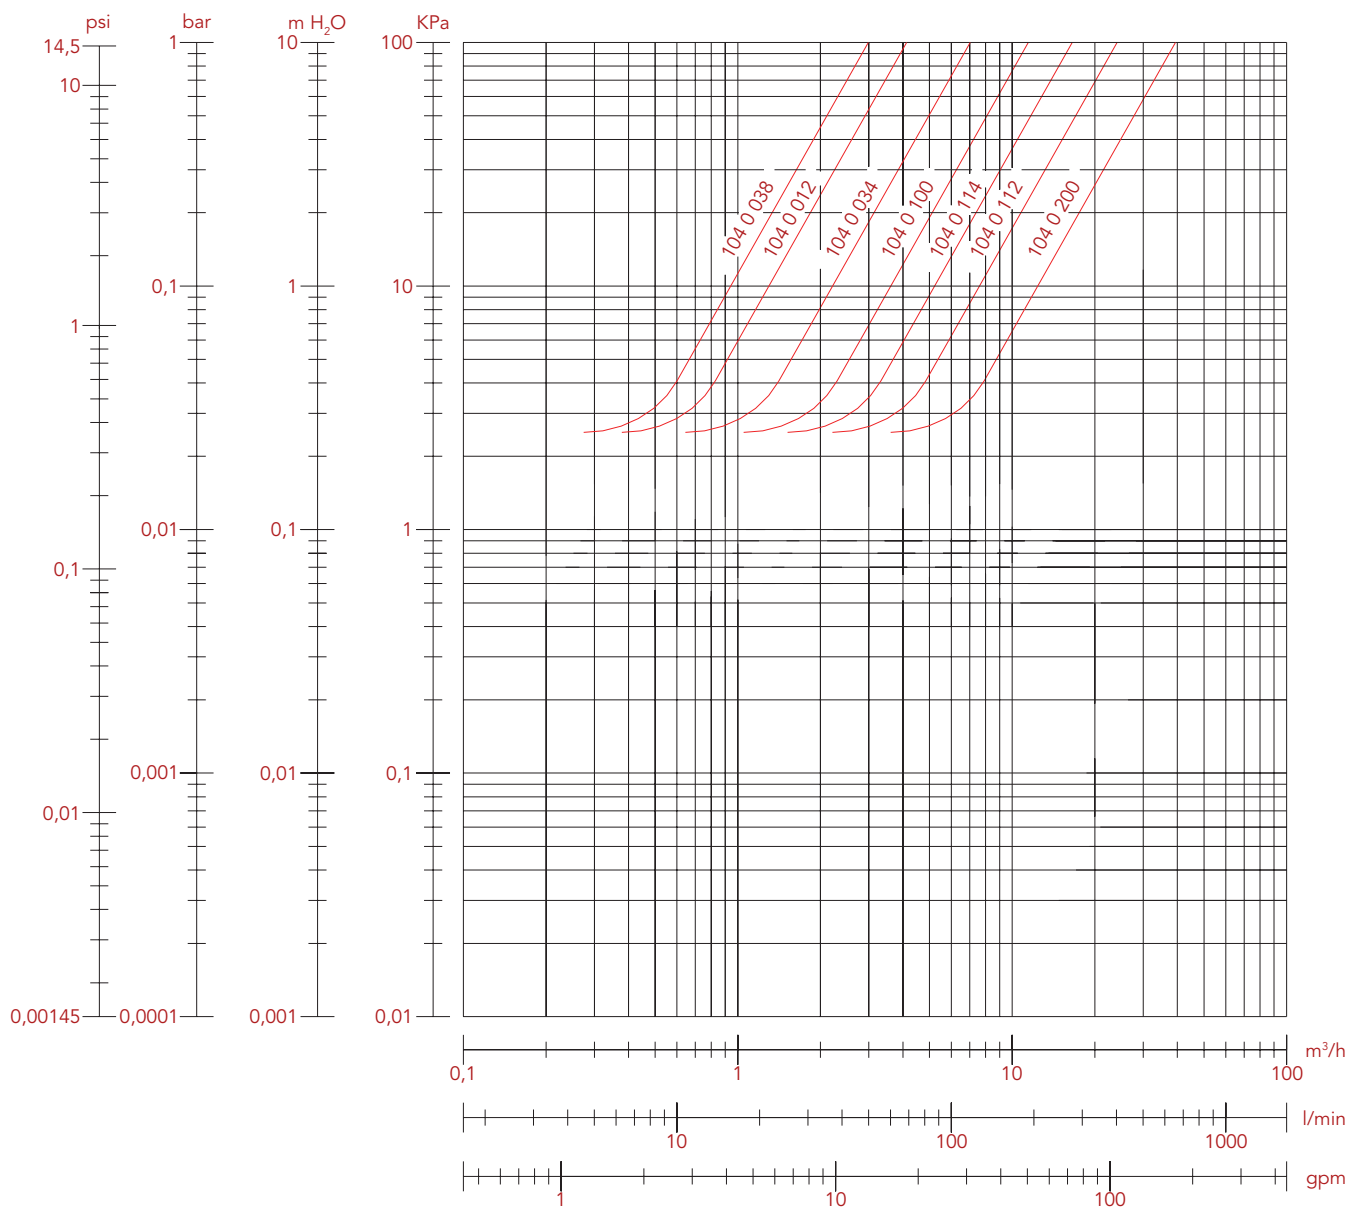

MISURE	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
Kv	2,99	4,12	7,03	11,45	16,54	24,12	39,32

Dates given by laboratory CETIM accredited by RNE